

SUPERCEDES: New

EFFECTIVE: January 1, 2002

#5401112-REVB


Use the drawing below as a template and trim at the dotted arc when trimming the appropriate paddle for intermediate pipe sizes.

For the rigid paddle kit, the 6" paddle must be trimmed for all sizes between 1" and 6".

CAUTION:

The paddle must not touch the inside of the pipe or bind in any way.

FIG. 1

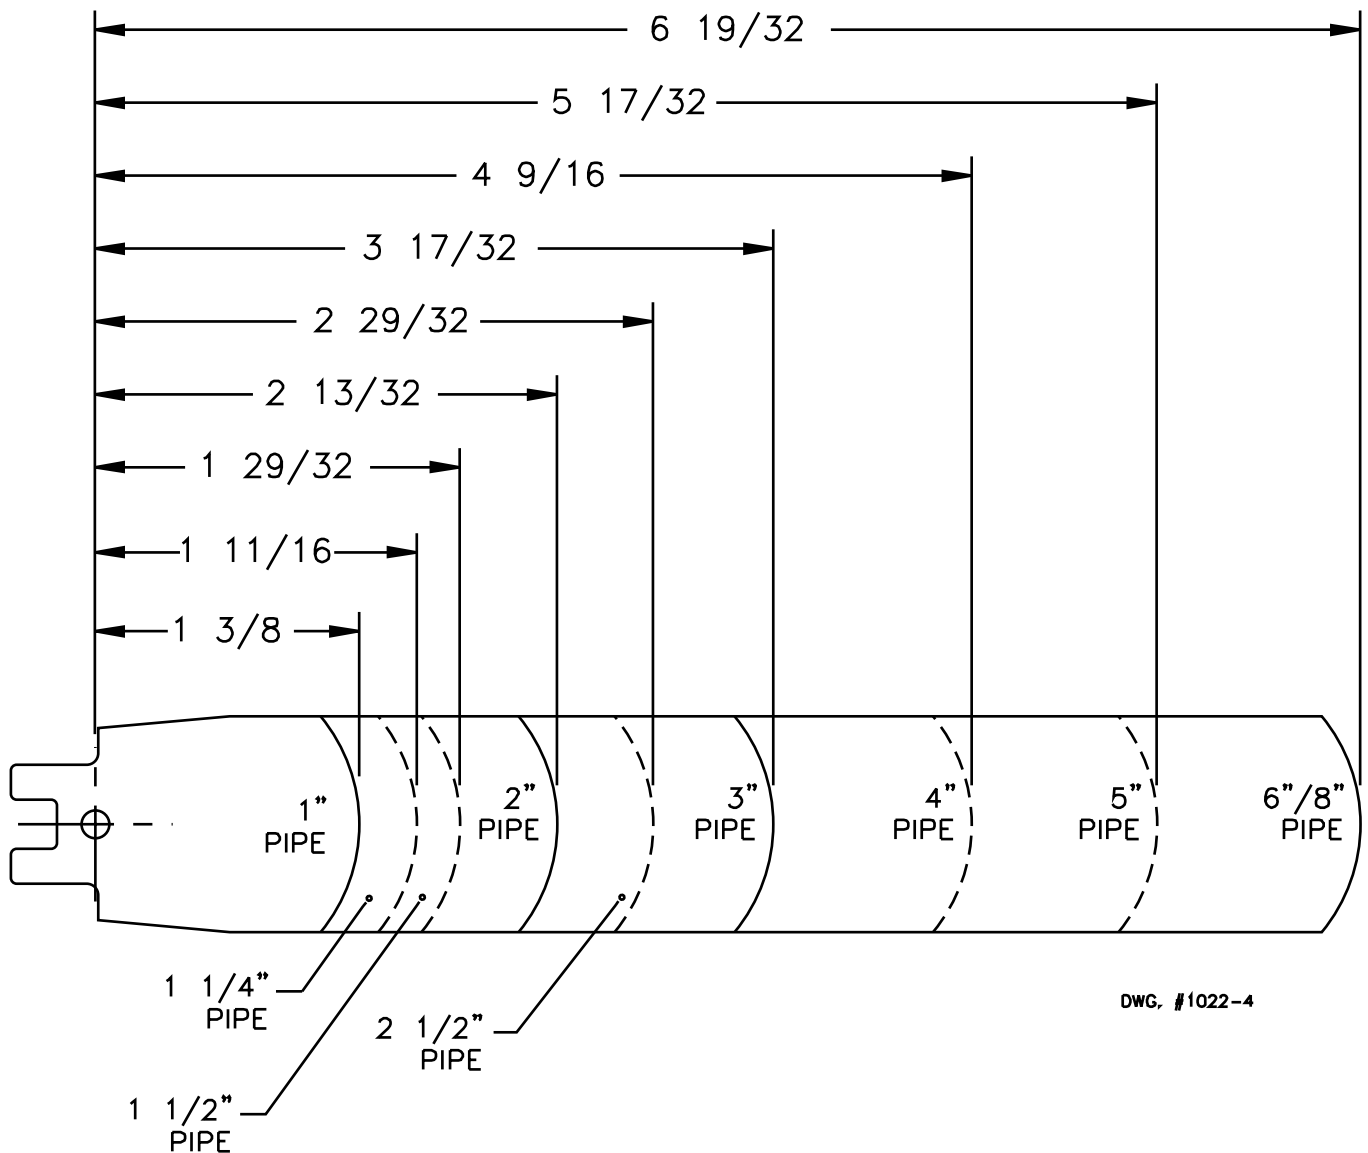

Flexible paddles smaller than the actual pipe size should be used for added support and higher sensitivity. See Fig. 2. The paddles must be properly attached and the screw that holds the paddle must be securely tightened.


FIG. 2

Typical paddle arrangement for 6" to 8" pipe, using smaller flexible paddles for added support and high sensitivity.

NOTE:

When installing **rigid paddles**, do not stack paddles. Only install **ONE** paddle that best fits the pipe.

Ordering	
PF-1	Standard Flexible Paddle Kit
PR-1	Rigid Paddle Kit

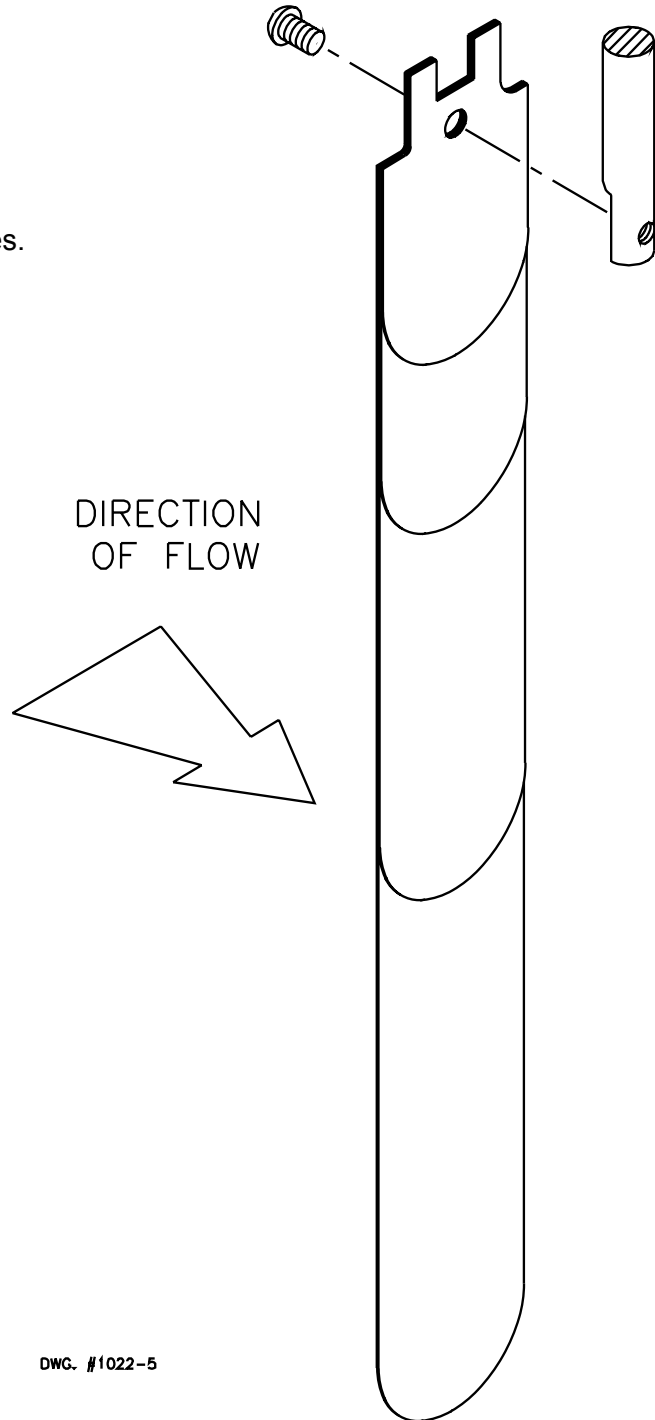

DWG. #1022-5

Taco Comfort Solutions™ A Taco Group Company

Taco, Inc., 1160 Cranston Street, Cranston, RI 02920 | Tel: (401) 942-8000 | FAX: (401) 942-2360

Taco (Canada), Ltd., 8450 Lawson Road, Suite #3, Milton, Ontario L9T 0J8 | Tel: (905) 564-9422 | FAX: (905) 564-9436

Visit our web site: www.TacoComfort.com | Printed in USA | ©2015 Taco, Inc.

