

Data sheet

Temperature controller AVT with safety temperature monitor STM / VGS for steam (PN 25)

Description



STM/VGS and STM/AVT/VGS are self-acting proportional temperature controllers used for temperature control and temperature monitoring primarily in steam or hot water applications for temperatures up to 200 °C.

VGS - valve with external thread

Controller closes on rising temperature.

The controllers are:

- Type-tested acc. to EN 14597 and protect against exceeding temperatures:
- District heating systems acc. to DIN 4747
- Heating systems acc. to EN 12828 (DIN 4751) and EN 12953-6 (DIN 4752)
- Water heating systems for drinking and industrial waters acc. to DIN 4753

Main data:

- DN 15-25
- k_{vs} 1,0-6,3 m³/h
- PN 25
- Setting ranges:
 - STM monitor: 20 ... 75 °C / 40 ... 95 °C / 30 ... 110 °C
 - AVT thermostatic actuator: -10 ... 40 °C / 20 ... 70 °C / 40 ... 90 °C / 60 ... 110 °C and 10 ... 45 °C / 35 ... 70 °C / 60 ... 100 °C / 85 ... 125 °C
- Temperature:
 - Steam/circulation water/glycolic water up to 30 %: 2 ... 200 °C
- Connections:
 - Ext. thread (weld-on, thread and flange tailpieces)
- Flow and return mounting

Ordering

Example 1 - **STM/VGS** controller: Safety temperature monitor for steam; DN 15; k_{vs} 1,6; PN 25; limit range 30 ... 110 °C; T_{max} 200 °C; ext. thread

- 1x VGS DN 15 valve
Code No: **065B0787**
- 1x STM monitor, 30 ... 110 °C
Code No: **065-0608**

Option:

- 1x Weld-on tailpieces
Code No: **003H6908**

All products will be delivered separately. The valve VGS will be delivered (assembled) together with an adapter M34 x M45.

VGS valve ¹⁾

Picture	DN (mm)	k_{vs} (m ³ /h)	Connection	Code No.		
	15	1,0	Cylindrical external thread acc. to ISO 228/1	065B0786		
		1,6		065B0787		
		3,2		065B0788		
	20	4,5		G 1 A	065B0789	
		25		6,3	G 1 1/4 A	065B0790

¹⁾ Adapter M34 x M45 for connection to STM thermostat is factory assembled on the valve.
(info: Adapter M34 x M30 for connection to AMV(E) electrical actuators is part of the valve delivery too.)

STM Safety temperature monitor (actuator)

Picture	For valves	Limit range (°C)	Temperature sensor with brass immersion pocket, length, connection	Code No.
	DN 15-50	30 ... 110	210 mm, R 3/4 ¹⁾	065-0608
		20 ... 75		065-0609
		40 ... 95		065-0610

¹⁾ conic male thread EN 10226-1

Ordering (continuous)

Example 2 - **STM/AVT/VGS** controller:

Temperature controller with safety temperature monitor for steam; DN 15; k_{vs} 1,6; PN 25; limit range 30 ... 110 °C; setting range 40 ... 90 °C; T_{max} 200 °C; ext. thread

- 1x VGS DN 15 valve
Code No: **065B0787**
- 1x STM monitor, 30 ... 110 °C
Code No: **065-0608**
- 1x AVT thermostatic actuator, 40 ... 90 °C
Code No: **065-0598**
- 1x K2 combination piece
Code No: **003H6855**

Option:

- 1x Weld-on tailpieces
Code No: **003H6908**

All products will be delivered separately. The valve VGS will be delivered (assembled) together with an adapter M34 x M45.

AVT thermostatic actuator

Picture	For valves	Setting range (°C)	Temperature sensor with brass immersion pocket, length, connection	Code No.
	DN 15-25	-10 ... +40	210 mm, R ¾ ¹⁾	065-0600
		20 ... 70		065-0601
		40 ... 90		065-0602
		60 ... 110		065-0603
		10 ... 45	255 mm, R ¾ ^{1) 2)}	065-0604
		35 ... 70		065-0605
		60 ... 100		065-0606
		85 ... 125		065-0607

¹⁾ conic male thread EN 10226-1

²⁾ without immersion pocket

Accessories for valves

Picture	Type designation	DN	Connection	Code No.
	Weld-on tailpieces	15	-	003H6908
		20		003H6909
		25		003H6910
	External thread tailpieces	15	Conical ext. thread acc. to EN 10226-1	R ½ 003H6902
		20		R ¾ 003H6903
		25		R 1 003H6904
	Flange tailpieces	15	Flanges PN 25, acc. to EN 1092-2	003H6915
		20		003H6916
		25		003H6917

Accessories for thermostats

Picture	Type designation	For controllers	Material	Code No.
	Immersion pocket PN 25	AVT/VGS	Brass	065-4416 ¹⁾
		STM/VGS	Stainless steel, mat. No. 1.4435	065-4417 ¹⁾
	Adapter ²⁾		M34 x 1,5 mm/M45 x 1,5 mm	003H6927
	Combination piece K2			003H6855
	Combination piece K3			003H6856

¹⁾ Not for AVT thermostatic actuator code numbers: **065-0604, 065-0605, 065-0606, 065-0607**

²⁾ Adapter for VGS combinations with thermostatic actuator AVT, temperature monitors STM and temperature limiters STL

Service kits

Picture	Type designation	for valves DN	k_{vs}	Code No.
	Valve body extension with stuffing box	15	3,2	003H6877
		20	4,5	
		25	6,3	
	Housing of sensor stuffing box	for sensors		Code No.
		AVT R ¾		065-4421

Technical data
VGS valve

Nominal diameter		DN	15			20	25
k_{vs} value	m^3/h		1,0	1,6	3,2	4,5	6,3
Stroke	mm		3			5	
Control ratio			> 1:50				
Control characteristic			linear				
Cavitation factor z			$\geq 0,6$				$\geq 0,55$
Leakage acc. to standard IEC 534	% of k_{vs}		$\leq 0,05$				
Nominal pressure	PN		25				
Max. differential pressure	bar		10				
Medium			Steam/Circulation water/glycolic water up to 30 %				
Medium pH			Min. 7, max. 10				
Medium temperature	$^{\circ}C$		2 ... 200				
Connections	valve		External thread				
	tailpieces		Weld-on, external thread and flange				
Materials							
Valve body			Red bronze CuSn5ZnPb (Rg5)				
Valve seat			Stainless steel, mat. No. 1.4571				
Valve cone			Stainless steel, mat. No. 1.4122				
Pressure relieve system			Bellows				

STM Safety temperature monitor (actuator)


Limit range X_s	$^{\circ}C$		30 ... 110 / 20 ... 75 / 40 ... 95				
Time constant T acc. to EN 14597	s		max. 100				
Gain K_s	$mm/^{\circ}K$		0,3				
Max. adm. temperature at sensor			80 $^{\circ}C$ above maximum setpoint				
Max. amb. temperature at thermostat	$^{\circ}C$		0 ... 70				
Nominal pressure sensor	PN		25				
Nominal pressure immersion pocket							
Capillary tube length	m		5				
Materials							
Temperature sensor			Cooper				
Immersion pocket	Ms design		Brass, nickel-plated				
	Stainless steel design		mat. No. 1.4435				
Handle for temp. setting			Polyamide, glass fiber-reinforced				
Scale carrier			Polyamide				

AVT Thermostatic actuator


Setting range X_s	$^{\circ}C$		-10 ... 40 / 20 ... 70 / 40 ... 90 / 60 ... 110 10 ... 45 / 35 ... 70 / 60 ... 100 / 85 ... 125				
Time constant T acc. to EN 14597	s		max. 50 (210 mm), max. 30 (255 mm)				
Gain K_s	$mm/^{\circ}K$		0,3 (210 mm); 0,7 (255 mm)				
Max. adm. temperature at sensor			50 $^{\circ}C$ above maximum setpoint				
Max. amb. temperature at thermostat	$^{\circ}C$		0 ... 70				
Nominal pressure sensor	PN		25				
Nominal pressure immersion pocket							
Capillary tube length			5 m (210 mm), 4 m (255 mm)				
Materials							
Temperature sensor			Cooper				
Immersion pocket ¹⁾	Ms design		Brass, nickel-plated				
	Stainless steel design		Mat. No. 1.4435 (210 mm)				
Handle for temp. setting			Polyamide, glass fiber-reinforced				
Scale carrier			Polyamide				

¹⁾ for sensor 210 mm

Application principles

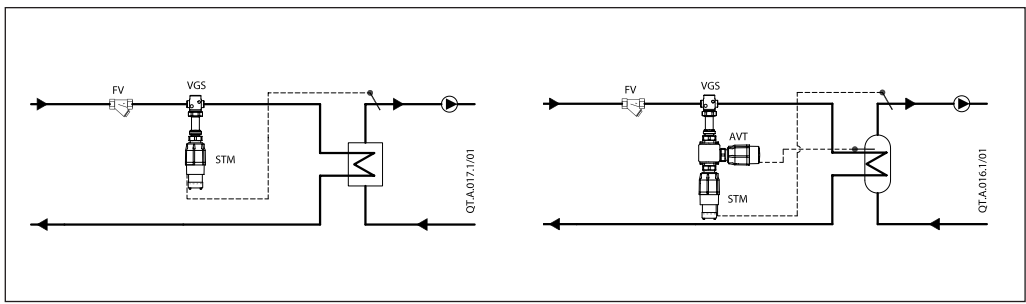

Combinations


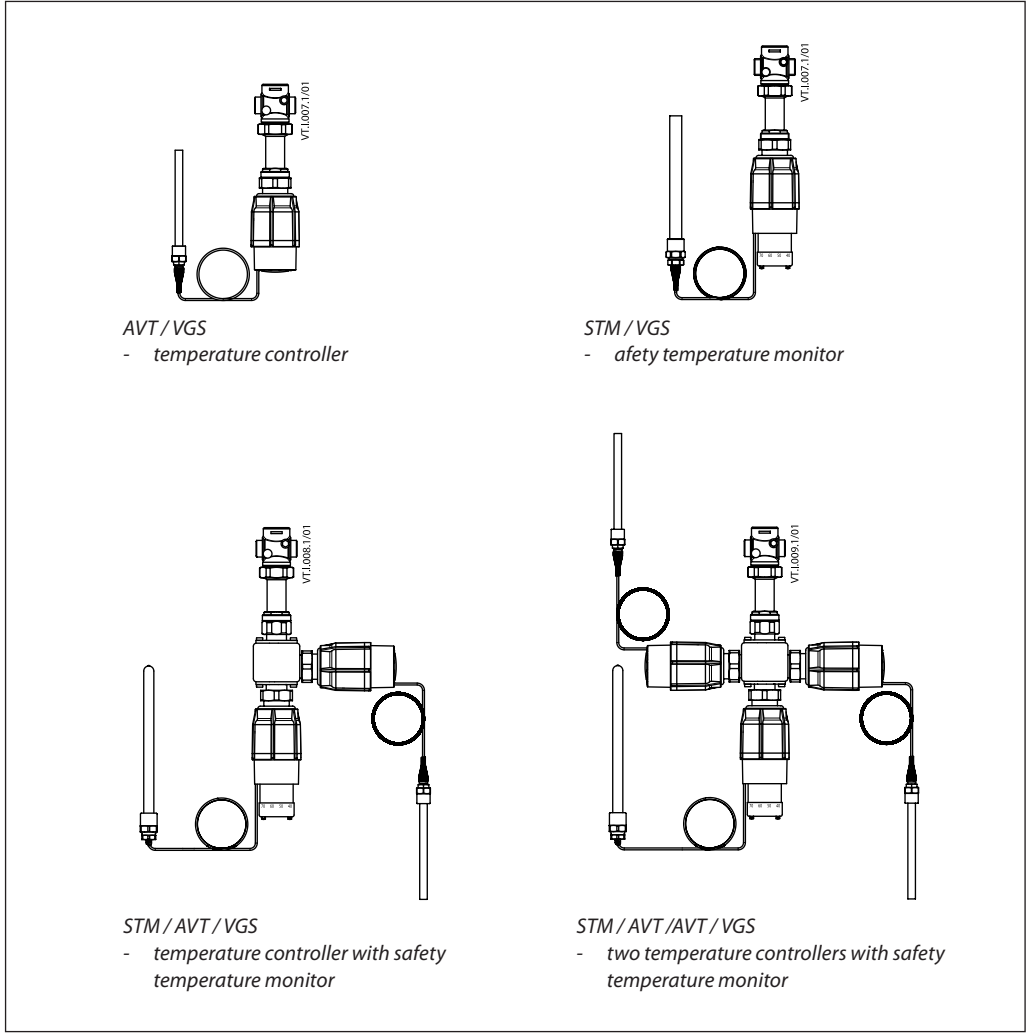


Installation positions

Temperature controller and safety temperature monitor

Up to medium temperature of 160 °C temperature controller AVT/VGS and safety temperature monitor STM/VGS can be installed in any position.

For higher temperatures temperature controller AVT/VGS and safety temperature monitor STM/VGS have to be installed horizontal and in horizontal pipes with the actuator oriented downwards.

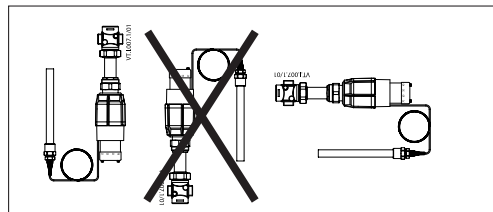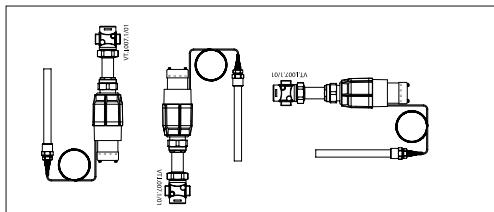

Temperature sensor



The place of installation must be chosen in a way that the temperature of the medium is directly taken without any delay. Avoid overheating of temperature sensor. The temperature sensor must be immersed into the medium in its full length.

Temperature sensors 170 mm R $\frac{1}{2}$ and 210 mm R $\frac{3}{4}$


- The temperature sensor may be installed in any position.

Temperature sensor 255 mm R $\frac{3}{4}$

- The temperature sensor must be installed as shown on the picture.

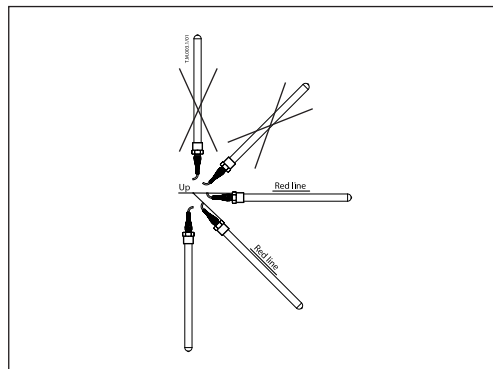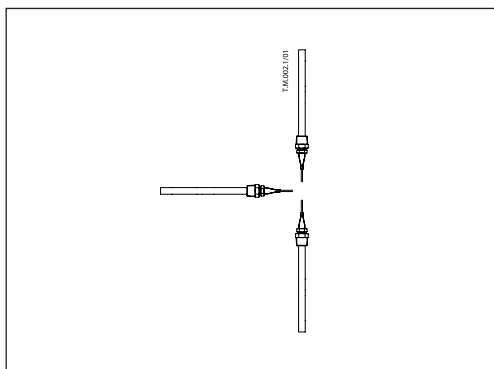


Pressure temperature diagram

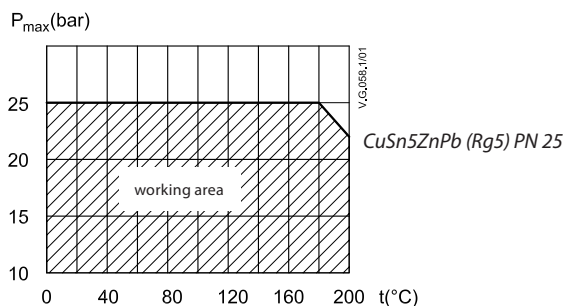

Maximum allowed operating pressure as a function of medium temperature (according to EN 1092-3).

Valve sizing

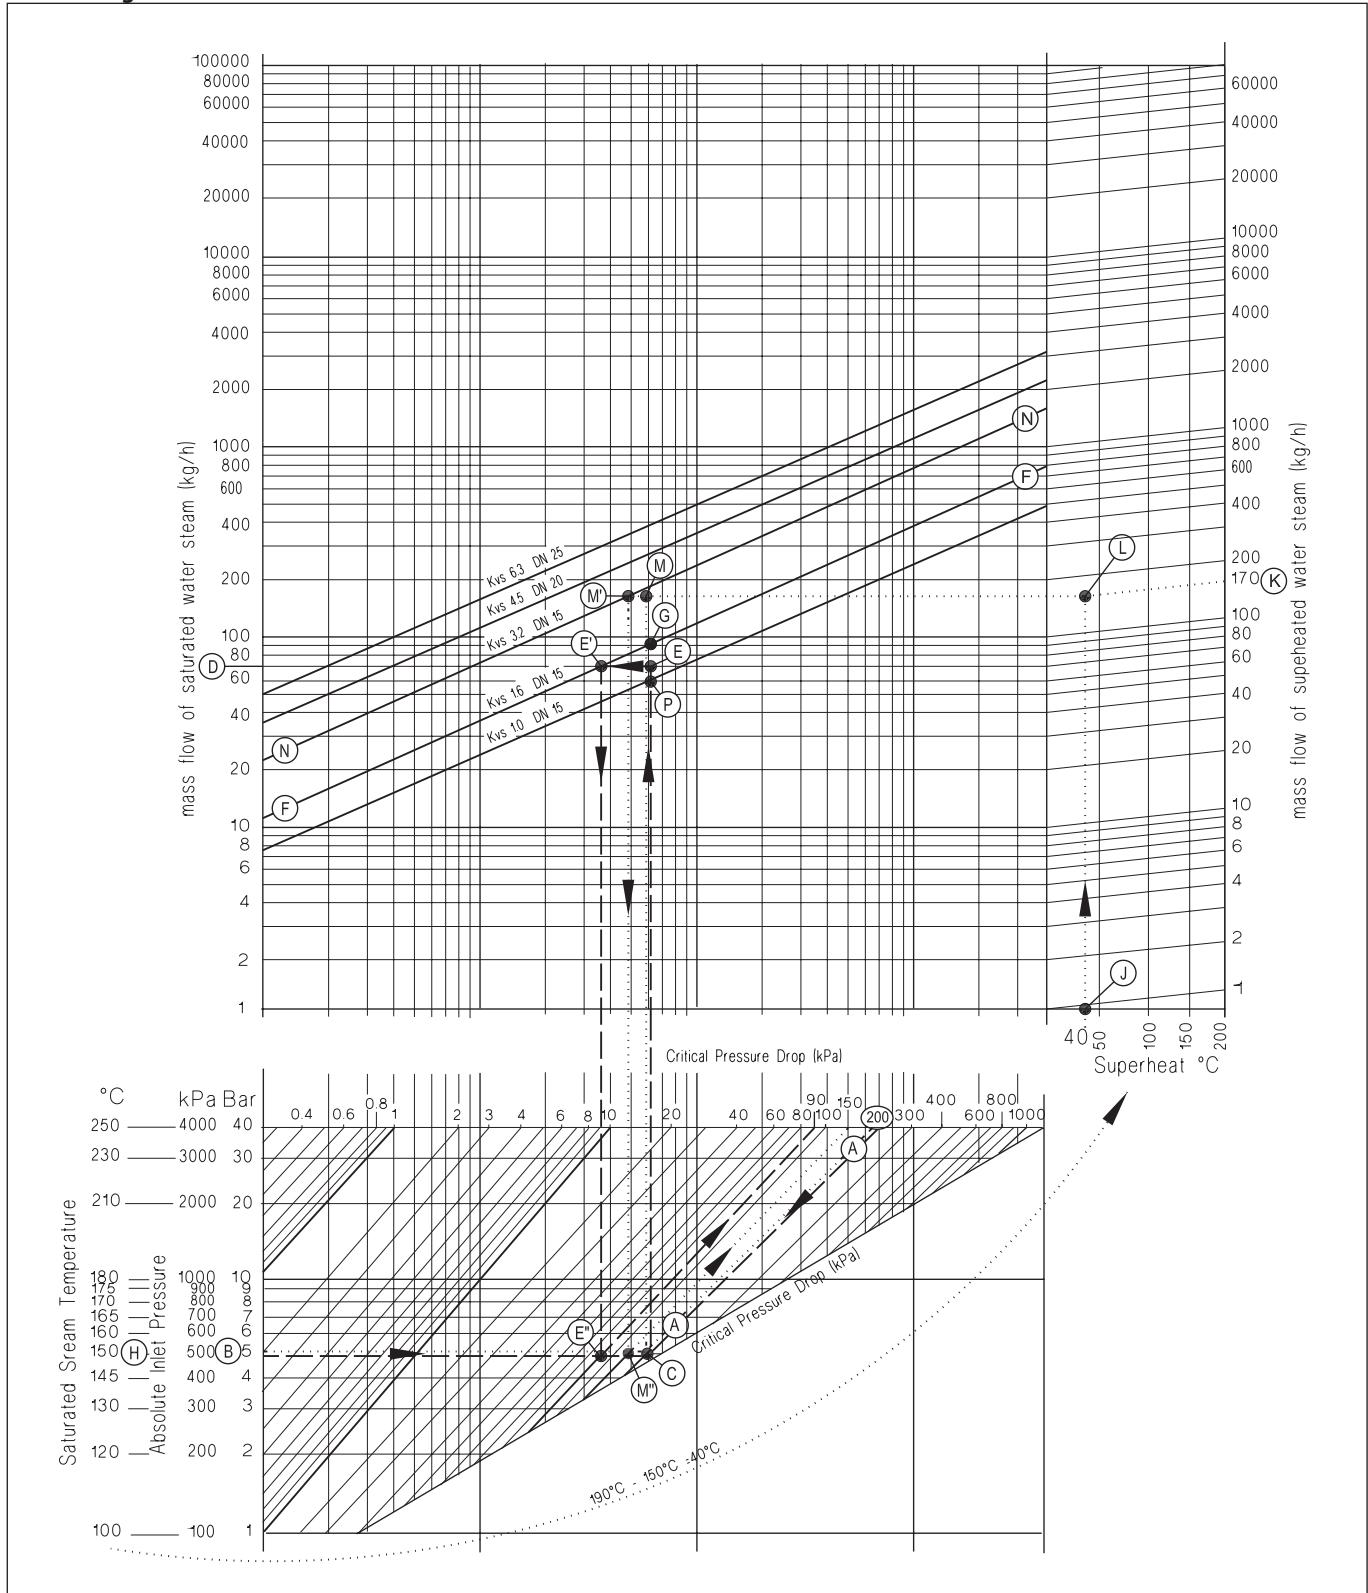

Steam valve sizing is based on 40 % drop of the steam pressure across the valve when fully open. At this condition the steam is travelling at or close to its critical velocity (approx. 300 m/s) and throttling would occur over the full valve stroke.

If the steam is travelling slower than this, then the first part of the valve stroke would merely increase the velocity of the steam without reducing the volumetric flow.

Valve sizing (*continuous*)

1. For saturated steam

Given data:
 Flow rate: 70 kg/h
 Absolute inlet pressure: 5 bar (500 kPa)

Remark:
 For this example follow dashed line

The absolute inlet pressure is 500 kPa. Critical pressure drop (40 % of 500 kPa) is 200 kPa. Locate the diagonal line corresponding to the pressure drop of 200 kPa (line A-A).

Read the absolute inlet pressure on the lower left hand scale (point B), and draw a horizontal line across until it meets the pressure drop diagonal A-A at point C.

From this point C extend a vertical line upwards until it meets the horizontal line representing the steam flow of 70 kg/h from point D. The intersection of this is point E.

The nearest diagonal k_{vs} line above this is line F-F with a k_{vs} of 1,6. If the ideal valve size is not available the next largest size should be selected to ensure design flow.

The pressure drop through valve at the flow rate is found by the intersection of the 70 kg/h line with F-F (point E') and dropping a vertical line downwards; this actually hits the horizontal line for 500 kPa absolute inlet pressure (point E'') at a pressure drop diagonal of 90 kPa. This is only 18 % of the pressure drop across the valve and the control quality will not be good until the valve has partially closed. As with all steam valves this compromise is necessary since the next smaller valve would not pass the required flow (maximum flow would be about 60 kg/h; point P).

The maximum flow for the same inlet pressure is found by extending the vertical line (C-E) through point E until it crosses the k_{vs} 1,6 line F-F (point G) and reading off the flow (90 kg/h).

2. For superheated steam

Given data:
 Flow rate: 170 kg/h
 Absolute inlet pressure: 5 bar (500 kPa)
 Steam temperature: 190 °C

Remark:
 For this example follow dotted line

The procedure for superheated steam is much the same as for saturated steam, but uses a different flow scale which slightly elevates the readings according to the degree of superheat.

As before, the diagonal critical pressure drop line A-A is located at 40 % of 500 kPa (200 kPa). The horizontal inlet pressure line through point B is now extended to the left to read off the corresponding saturated steam temperature at point H (150 °C). The difference between the saturated steam temperature and the superheated steam temperature is 190 °C – 150 °C = 40 °C (see point J).


The superheated steam flow 170 kg/h is found on the upper right hand scale (point K). From here the diagonal line is followed down until it meets a vertical line from the steam temperature elevation (40 °C, point J) at point L.

As before, the horizontal line through point B is drawn to cut line A-A at point C. The point where the vertical line from point C meets the horizontal line from point L is the operating point (point M). This horizontal line, L-M, is the corrected flow line. The nearest diagonal line above this is line N-N with a k_{vs} 3,2. A vertical line dropped from the intersection of L-M line with line N-N (point M') intersects the 500 kPa absolute inlet pressure line (point M'') at a pressure drop diagonal of about 150 kPa. This is about 30 % of the pressure drop across the valve which will give reasonable control quality (compared to recommended ratio of 40 %).

Design


STM/VGS

1. Valve VGS
2. Valve insert
3. Pressure relieved valve cone
4. Valve stem
5. Valve body extension
6. Union nut
7. Safety temperature monitor STM
8. Thermostat stem
9. Setting spring for temperature control
10. Handle for limit setting, prepared for sealing
11. Scale carrier
12. Capillary tube
13. Temperature sensor
14. Immersion pocket
15. Safety spring

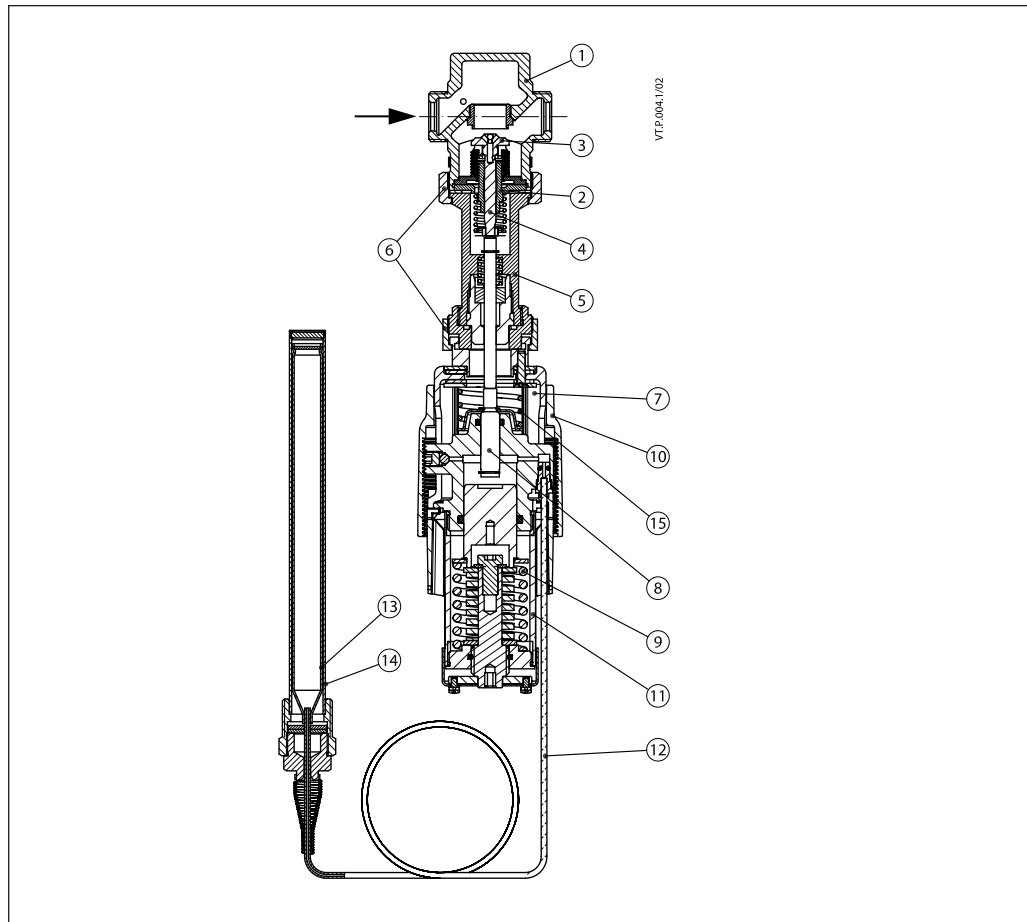

AVT/VGS

1. Valve VGS
2. Valve insert
3. Pressure relieved valve cone
4. Valve stem
5. Valve body extension
6. Union nut
7. Thermostatic actuator AVT
8. Thermostat stem
9. Bellows
10. Setting spring for temperature control
11. Handle for temperature setting, prepared for sealing
12. Scale carrier
13. Capillary tube
14. Flexible protected pipe (only at AVT 255 mm)
15. Temperature sensor
16. Immersion pocket
17. Sensor stuffing box
18. Housing of sensor stuffing box

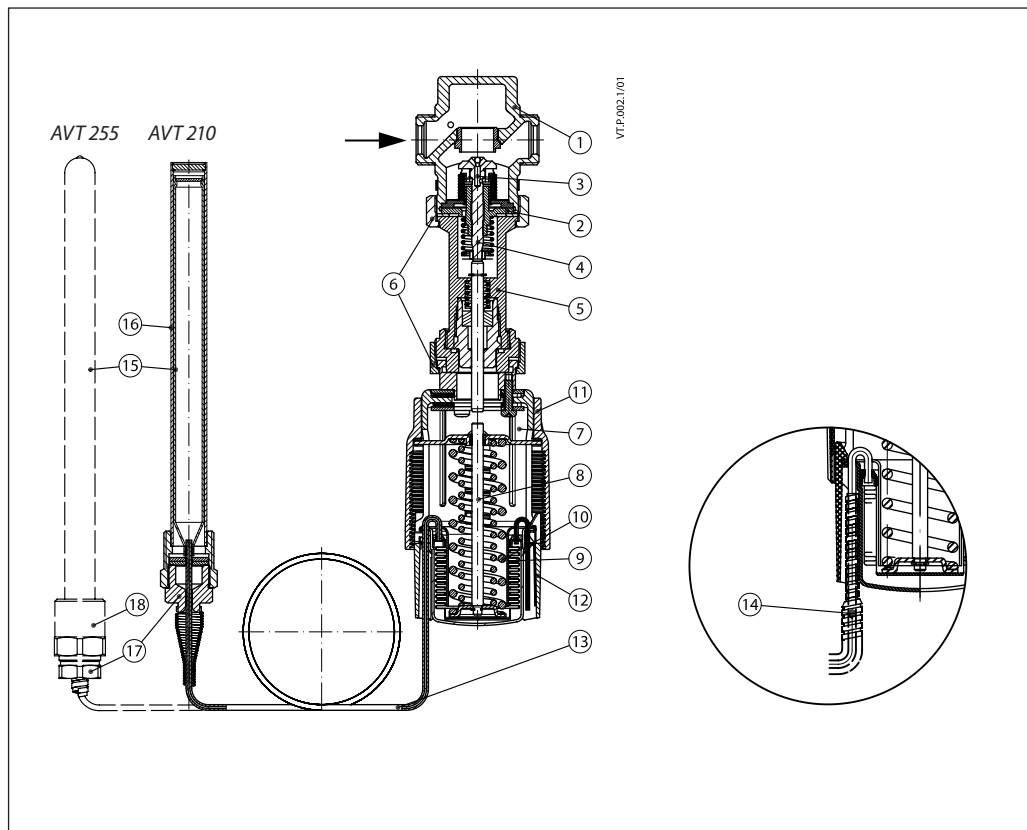

Function

Mode of Operation

The safety temperature monitor is proportional temperature controller which controls the temperature and protects the system against exceeding temperatures. The valve cone is soft sealed and pressure relieved.

Safety Temperature Monitor (STM/VGS)

- Function
In case the temperature at the temperature sensor exceeds the adjusted set point, safety temperature monitor interrupts energy supply by closing the valve. As soon as the temperature at the temperature sensor drops, the valve opens automatically.

Handle for limit setting can be sealed

- Extended safety function
If there is a leakage in the area of the temperature sensor, the capillary tube, or the thermostat, the valve closes by a spring in the safety thermostat. In this case safety temperature monitor (actuator) must be replaced.

- Physical Function Principle
The safety temperature monitor operates in accordance with the liquid expansion principle. The temperature sensor, the capillary tube and the bellows are filled with liquid. As the temperature at the temperature sensor rises, the liquid expands, the thermostat stem moves out and closes the valve.

Temperature Controller (AVT/VGS)

- Function
By increasing of medium temperature valve cone moves towards the seat (valve closes), by decreasing of medium temperature valve cone moves away from the seat (valve opens).

Handle for temperature setting can be sealed.

- Physical Function Principle
Medium temperature changes cause pressure changes in temperature sensor. Resulting pressure is being transferred through the capillary tube to the bellows. Bellows moves thermostat stem and opens or closes the valve.

Settings

Temperature setting (AVT/VGS)

Temperature setting is being done by the adjustment of the setting spring for temperature control. The adjustment can be done by means of handle for temperature setting and/or temperature indicators.

Limit setting (STM/VGS)

Limit setting is being done by the adjustment of the setting spring for temperature control. The adjustment can be done by means of handle for limit setting and/or temperature indicators.

Adjustment diagram

Temperature setting

Relation between scale numbers 1-5 and closing temperature.

Note: The values given are approximate


AVT Thermostat ... 210 mm					
I	II	III	III	IIII	
-10	3	15	28	40	°C
20	33	45	58	70	
40	53	65	78	90	
60	73	85	98	110	

AVT Thermostat ... 255 mm					
I	II	III	III	IIII	
10	19	28	36	45	°C
35	44	53	61	70	
60	70	80	90	100	
85	95	105	115	125	

Note:

STM Safety temperature monitor (actuator):
temperature scale is already written on the product

Dimensions

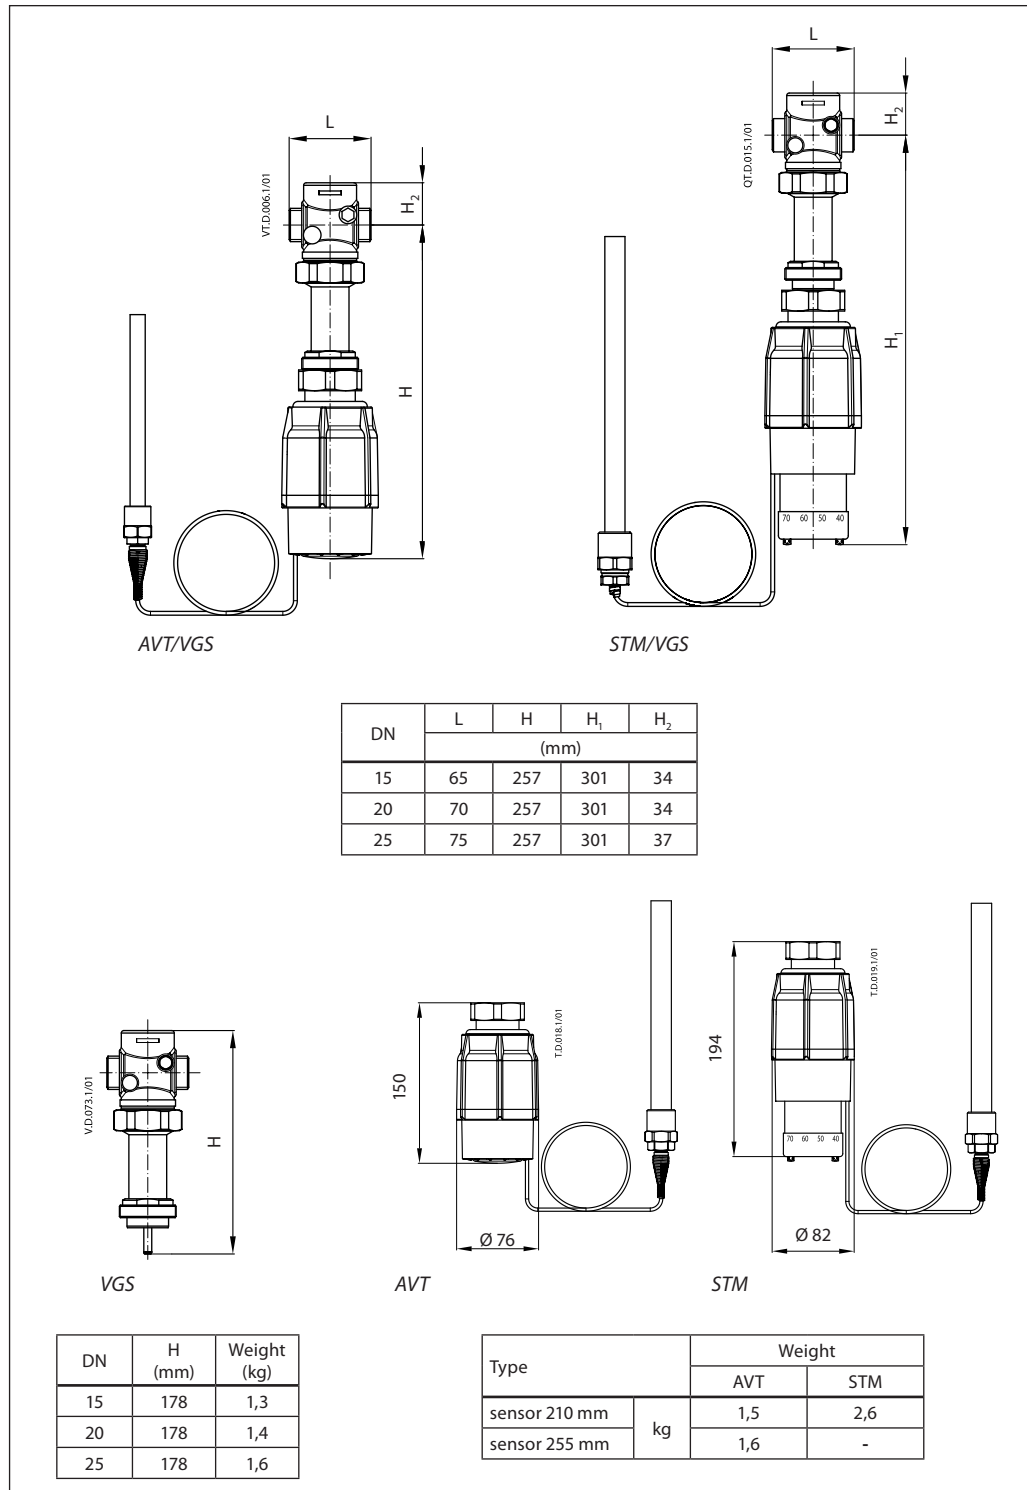

Dimensions (continuous)

